

THIS DRAWING IS FOR INFORMATION PURPOSES ONLY. THE CONTRACTOR SHALL BE RESPONSIBLE FOR PRODUCING WORKING DRAWINGS



| LEGEND | |
|--------|--|
| | 100mm SITE LIGHTING DUCTING IN ACCORDANCE WITH LOCAL AUTHORITY GUIDELINES |
| | SPARE 50mm DUCT INSTALLED ACROSS ALL DRIVEWAY APRONS & CAPPED AT BOTH ENDS |
| | DENOTES REF 'Z' LUMINAIRE MOUNTED ON 6.0M HIGH OCTAGONAL COLUMN POST TOP MOUNTED |
| | DENOTES REF 'Z1' LUMINAIRE MOUNTED ON 6.0M HIGH OCTAGONAL COLUMN POST TOP MOUNTED |
| | DENOTES REF 'Z2' LUMINAIRE MOUNTED ON 6.0M HIGH OCTAGONAL COLUMN POST TOP MOUNTED |
| | DENOTES 50mm DIA RED ESBN DUCT WITH 10mm NYLON ROPE DRAW WIRE SHALL BE INSTALLED FROM ESBN MINI PILLAR TO PL MICRO PILLAR |
| | PROPOSED ESBN MINI PILLAR LOCATION & SUPPLY POINT FOR PUBLIC LIGHTING SUBJECT TO AGREEMENT/CONFIRMATION WITH LOCAL ESBN AUTHORITY. |
| | DENOTES PUBLIC LIGHTING MICRO PILLAR IN ACCORDANCE WITH FCC SPECIFICATION DOCUMENT |
| | PROPOSED (800x800x850) CONCRETE DRAW PIT |

PROPOSED PUBLIC LIGHTING MICRO PILLAR. AT EACH MICRO PILLAR LOCATION THE CONTRACTOR SHALL ENSURE THAT A BARE OR HOT DIP GALV IRON EARTH ROD 16MM DIA SHALL BE BURIED TO A MINIMUM DEPTH OF 1200mm. EARTH RODS SHALL BE INSTALLED WITH SUITABLE INSPECTION BOX TO FACILITATE INSPECTION OF THE EARTH CONDUCTOR CONNECTION TO THE ROD.

COLUMN NUMBERING TO BE DEPLOYED ON EACH COLUMN AS REQUIRED BY LOCAL AUTHORITY.

50MM DIA RED ESBN DUCT WITH 10MM NYLON DRAW ROPE SHALL BE INSTALLED FROM ESBN MINI-PILLAR TO THE PUBLIC LIGHTING MICRO-PILLAR

PROPOSED MICRO PILLAR FOR PUBLIC LIGHTING TO BE PROVIDED AT A MINIMUM DISTANCE OF 2M FROM MINI-PILLAR. EXACT LOCATION TO BE AGREED WITH LOCAL AUTHORITY AND ESBN.

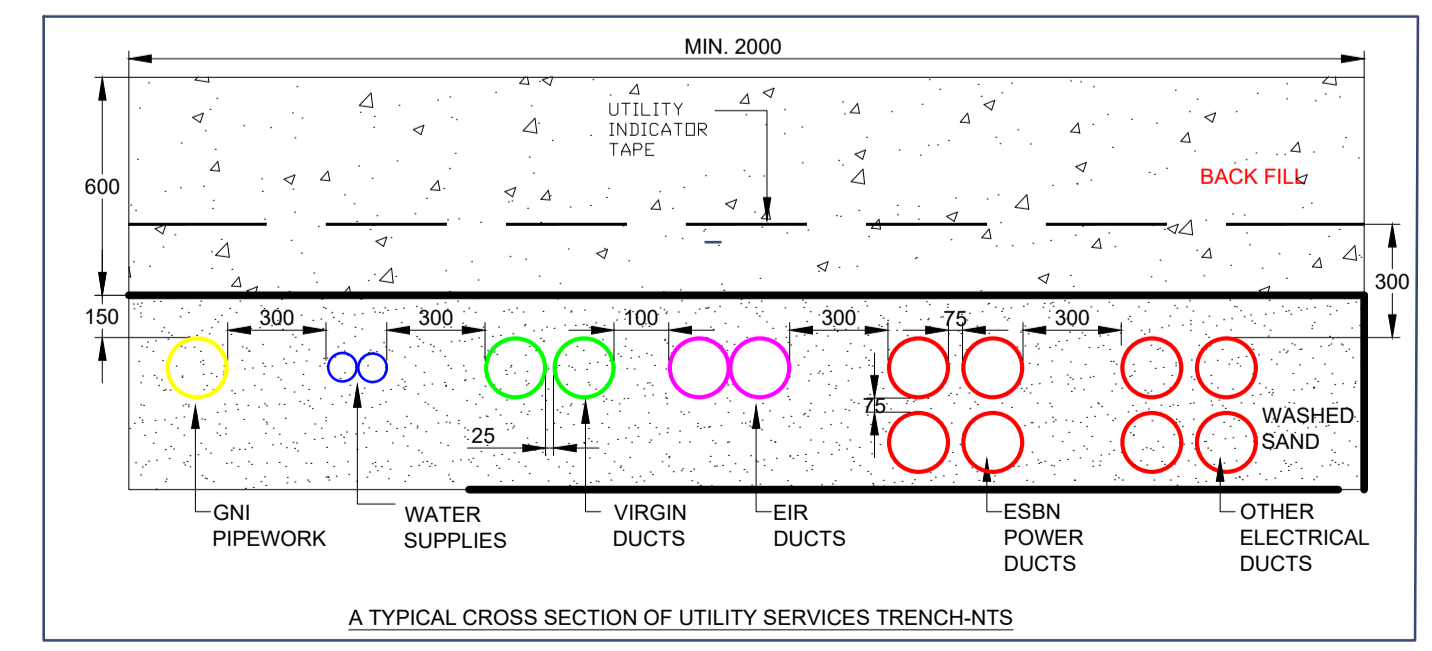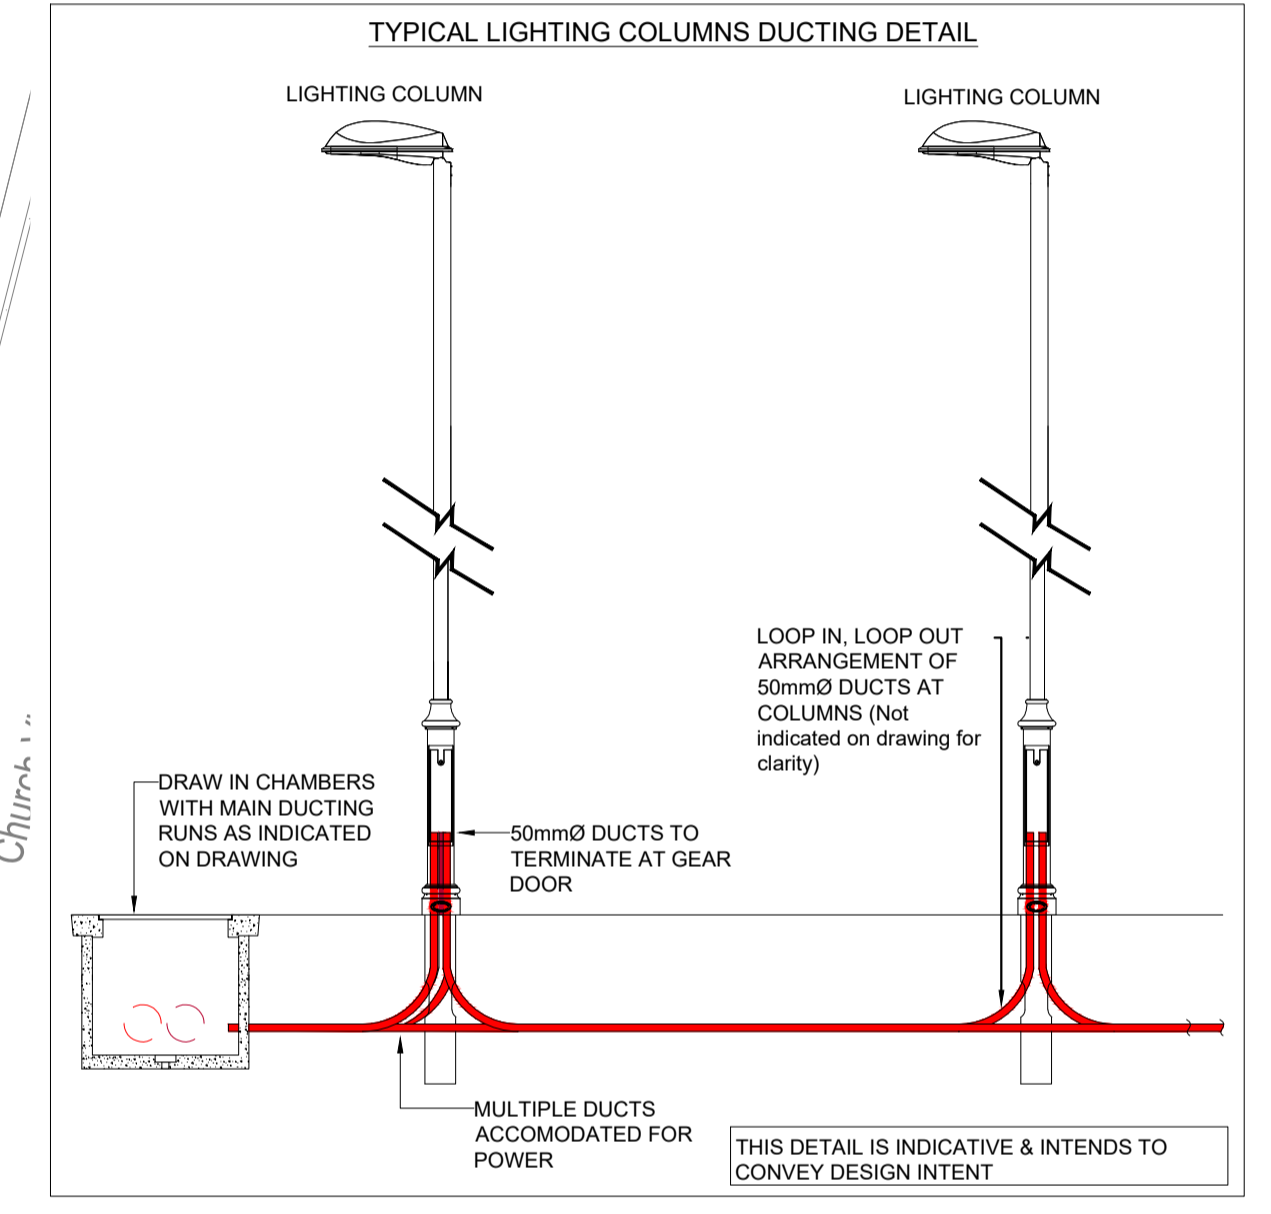

| P03 | PLANNING ISSUE - SITE LAYOUT UPDATED | SK | - | 14.04.2025 |
|-------------------------|--------------------------------------|-----|-----|------------|
| P02 | PLANNING ISSUE | SK | - | 20.03.2025 |
| P01 | ISSUED FOR STAGE 2 COSTING | SK | - | 15.10.2024 |
| REV | DESCRIPTION | DRN | CHK | DATE |
| ISSUE PRELIMINARY STAGE | | | | |

simple mckillop
 NATURALLY INNOVATIVE CONSULTING ENGINEERS
 Belfast +44 (0)28 90331700
 Castleblayney +353 (0)42 9749570
 www.semplemckillop.com admin@semplemckillop.com

PROJECT TITLE
 OWENMORE CRESCENT, COLLOONEY, CO. SLIGO

DRAWING TITLE
 SITE UTILITIES - PROPOSED PUBLIC LIGHTING INSTALLATION

DRAWING REFERENCE
 3102-SMK-XX-XX-DR-E-6005

DRN
 SK

SCALE
 A1 1:250